



TRAFFIC RATED PHOENIX IRON WORKS MH FRAME AND COVER #P-1090 MARKED "SANITARY SEWER" (TYP.)

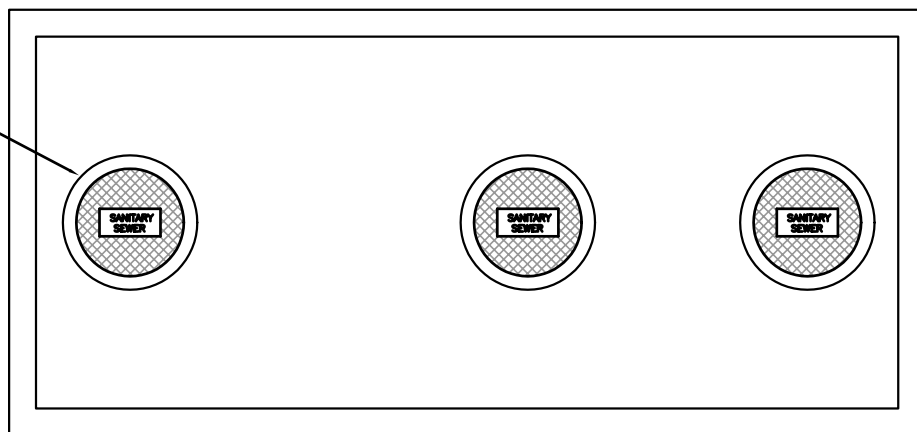


PCC SLAB

PLAN VIEW
NOT TO SCALE

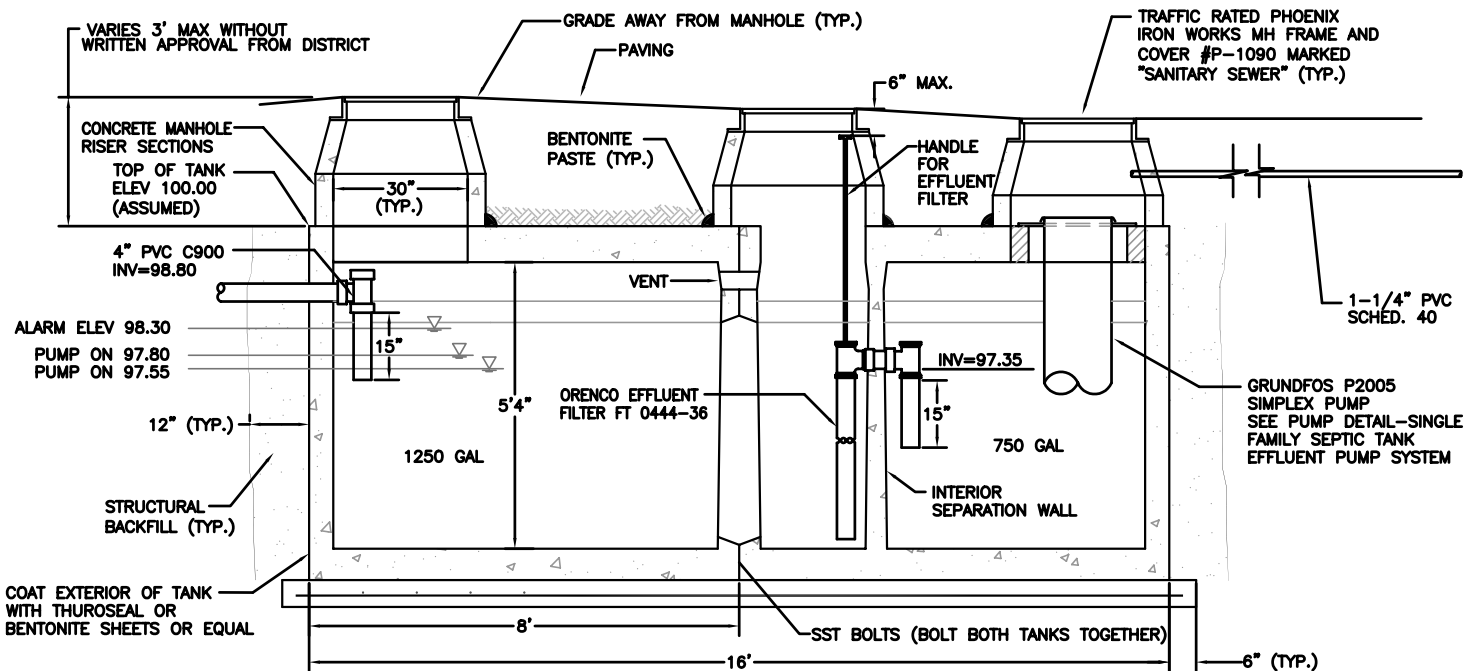

LONGITUDINAL TANK CROSS SECTION
NOT TO SCALE

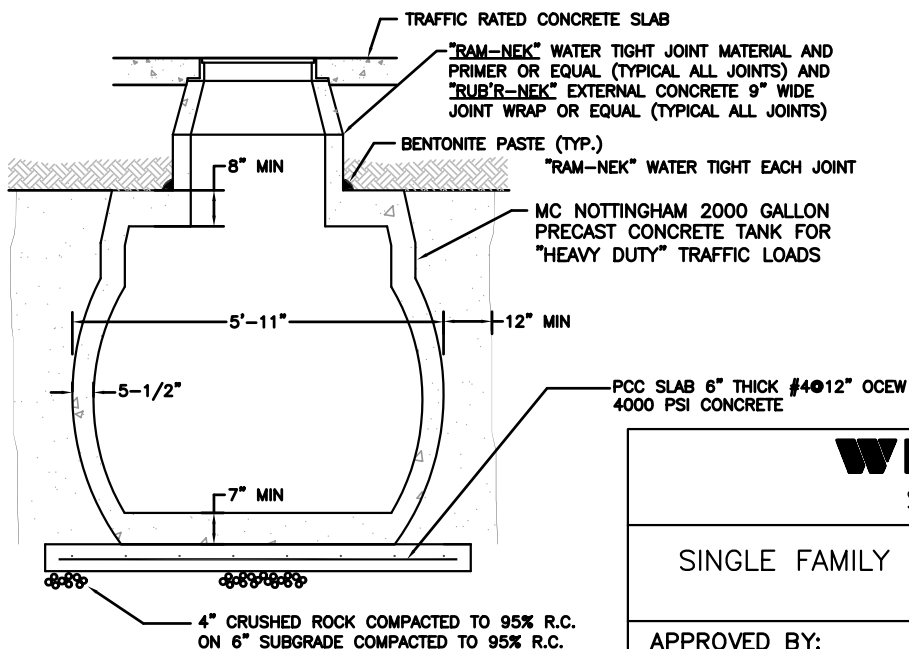

NOTE:

TANK SHALL BE A TWO COMPARTMENT PRECAST CONCRETE TANK WITH THREE MANHOLES AND GAS-TIGHT LIDS. THE SEDIMENT COMPARTMENT SHALL HAVE 1250 GAL. CAPACITY AND THE EFFLUENT COMPARTMENT SHALL HAVE 750 GAL. CAPACITY.

TYPICAL TANK CROSS SECTION
NOT TO SCALE

WEST BAY
SANITARY DISTRICT

SINGLE FAMILY SEPTIC TANK EFFLUENT PUMPING (STEP) SYSTEM

APPROVED BY:

TIMOTHY CLAYTON
DISTRICT MANAGER

4/18/2005
DATE: