


**NOTE:**

REQUIRED WHENEVER A SANITARY SEWER MAIN OR LATERAL CROSSES OVER A WATER MAIN.

**TYPICAL CROSSING OVER WATER MAIN**

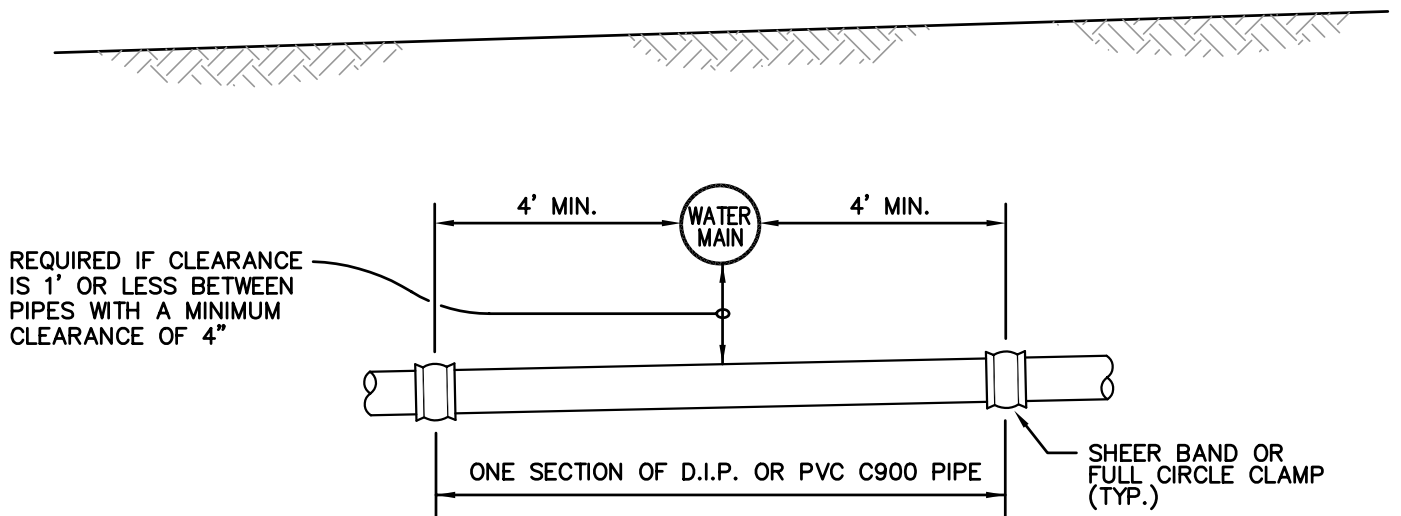

**TYPICAL CROSSING UNDER WATER MAIN**

**PIPE COVER**

LESS THAN 36": D.I.P. CLASS 50 OR 51  
PVC C-900 CLASS 200

36" OR DEEPER: PVC C-900 CLASS 150

<b>WEST BAY</b> SANITARY DISTRICT	
SANITARY SEWER WATER MAIN CROSSINGS	
APPROVED BY: TIMOTHY CLAYTON DISTRICT MANAGER	4/18/2005 DATE:
	23